



Model: ACWC-150-E-EXCH¹-__²-__³-__⁴

Description:

Two stage air-cooled portable water chiller system with additional process system heat exchanger. System capacity indicated on table is the approximate BTU/hr based on a leaving fluid temperature of 50°F with an ambient air temperature of 95°F.

CAPACITY ±5% AT 50° LCWT / 95°F AMBIENT		150,000 BTU /HR					
COMPRESSOR / REFRIGERANT		TANDEM HERMETIC SCROLL / R410A					
CONDENSER FANS / AIRFLOW		2 / 8000 CFM					
CONDENSER COILS TYPE		COPPER TUBE / ALUMINUM FIN					
EVAPORATOR TYPE		STAINLESS STEEL / COPPER BRAZED					
HEAT EXCHANGER TYPE		STAINLESS STEEL / COPPER BRAZED					
FLUID CONNECTIONS		1 1/4" MNPT (IN/OUT)					
ELECTRICAL:	V - Ø - HZ	COMP RLA / LRA (ea)		FAN FLA (ea)	PUMP FLA	MCA	MOCP
- 1	575 - 3 - 60	7.7	54	1.0	2.0	21.3	25
- 5	230 - 3 - 60	22.4	149	2.4	5.0	60.2	80
- 6	460 - 3 - 60	10.6	75	1.4	2.5	29.1	35
PUMP HP / OUTPUT		1.5 HP / 55 GPM @ 30 PSI					
TANK SIZE / CONSTRUCTION		80 GALLON / 304 STAINLESS STEEL TANK WITH LID					
DIMENSIONS		73 1/2" L x 39 1/2" W x 70" H					
WEIGHT (APPROX.)		1500 LBS					

Note: All specifications subject to change without notice. Specify voltage and ambient condition upon ordering.

MCA: Minimum circuit amps per UL 1995. MOCP: Maximum overcurrent protective device per UL 1995.

STANDARD FEATURES:

- **Controls:** Electronic programmed temperature controller with constant (set point & process) temperature readout.
- **Refrigeration Components:** Efficient scroll compressors, sight glass/moisture indicators, balanced port expansion valves, filter drier, pump down valves, fan cycling head pressure controls.
- **Process Fluid Components:** Heat exchanger for separation of chilled fluid circuit from process fluid circuit. Bronze "Y" strainer with 20 mesh stainless steel screen. Pumps are stainless steel centrifugal. Tanks are insulated with shoe box lid, fill port, and level sight glass. Portable systems will include a flow control valve.
- **Safety Controls:** High and low refrigerant pressure, high and low fluid temperature, freeze, low water flow, overloads for compressor and fan motors, safety fuses or overloads for pump.
- **Construction:** Welded steel powder coated frame and full metal cabinet, copper piping connections.
- **Warranty:** One year parts / five year compressor.

SUITABLE AMBIENT CONDITIONS/FEATURES:

- **IND:** Indoor use only. Casters on frame.
- **40:** Suitable for outdoor use with an ambient of 40°F ambient.
- **0:** Suitable for outdoor use to 0°F ambient. Includes low ambient fan speed controls with (LT) models.
- **M20:** Suitable for outdoor use to -20°F ambient. Includes low ambient fan speed controls with hot gas bypass. External wind baffles, optional.

¹ Flow Design (__=Portable, ST=Stationary, RF=Reverse Flow, EXCH=Extra Heat Exchanger, DP=Dual Pump, DR=Dual Return)

² Leaving Fluid Temperature (__=Standard, LT=Low Temperature-specify lowest temperature in °F)

³ Ambient Temperature Conditions (see above)


⁴ Electrical Power Code (see above)




TECHNICAL SPECIFICATION

WWW.WATERCHILLERS.COM


FRONT

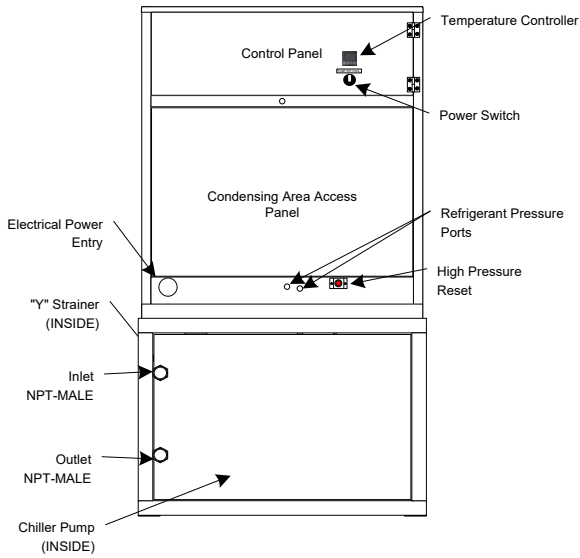


RIGHT SIDE

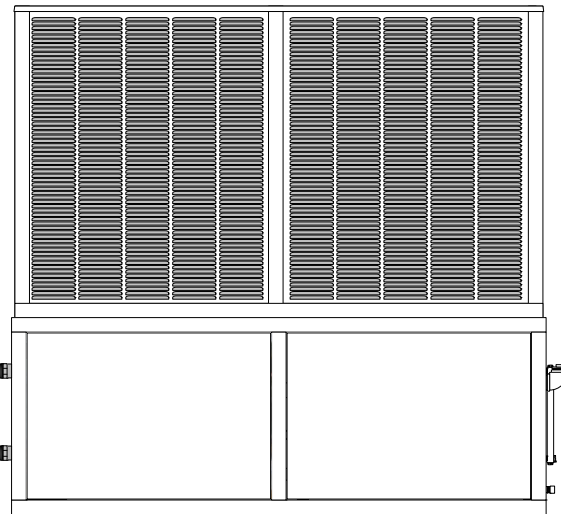


BACK

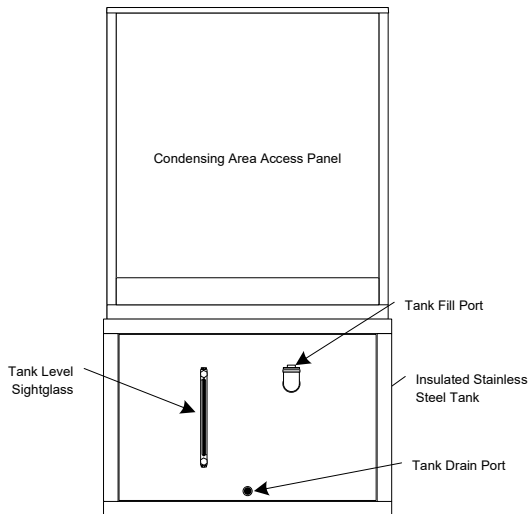

LEFT SIDE

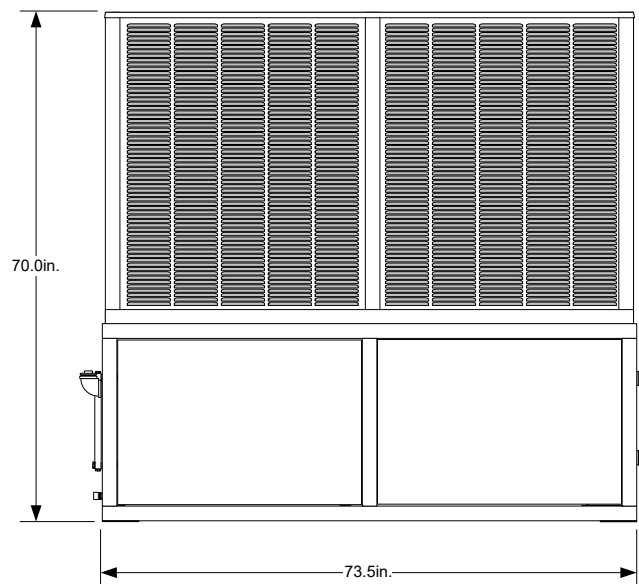

TOP

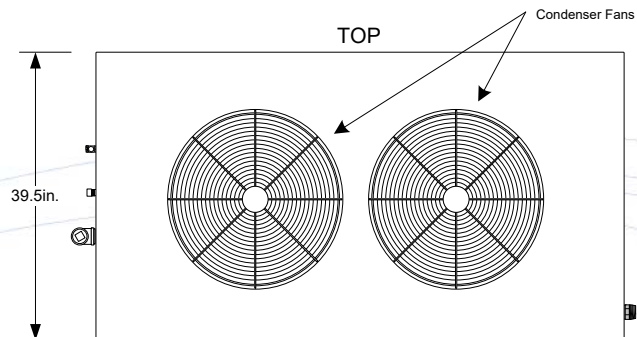

NOTES

- Unit should be installed with at least 4' clearance on all sides and a minimum of 8' clear air space above the unit
- Dimensions are approximate. (inches)
- Casters (Optional)
- All specifications subject to change without notice.

COLD SHOT CHILLERS

DRAWN ENGINEERING

ISSUED 6/4/2020

SIZE

A

DIMENSION NOTES

Dimensions are in inches
Unless otherwise specified. $\pm 1/4"$

DWG NO

INSTALLATION DRAWING
ACWC-150-E- (Typical)

REV

1

SCALE

NONE


DWG-INST_ACWC-150-E-(0520).vsd

SHEET


5 / Front-Back-Top-Sides_EXCH



HEAT EXCHANGER (EXCH)

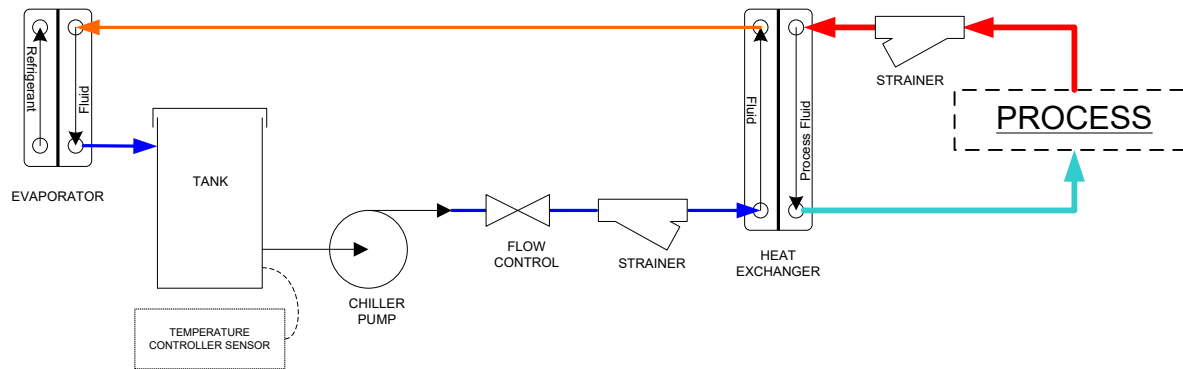

Line Guide



COLD SHOT CHILLERS

DRAWN

ENGINEERING

ISSUED

5/2020

SIZE

A

SCALE

NONE

NOTES

- All designs are subject to change without notice.
- The diagrams are to be used as a basic flow diagram only.
- Color Code is for relative temperature comparison.
- Additional components may be included.
- Evaporator may be located in tank.

DESCRIPTION

Typical FLOW OPTIONS for Chiller Circuits

REV

1

DWG-CKT_ChillerCircuitFlowOptions-Typical_(0520).vsd

SHEET

2 / Heat Exchanger (EXCH)